

CERTIFICATE

of Conformity of the Factory Production Control

1922 - CPR - 0865

In compliance with Regulation (EU) No 305/2011 of the European Parliament and of the council of 9 March 2011 (the Construction Products Regulation or CPR), this certificate applies to the construction products

Chimneys. Requirements for metal chimneys. System chimney products. Metal flue liners and connecting flue pipes

(The relevant thicknesses and diameters of the product are described in Annex I, that is an inseparable part of this certificate.)

placed on the market under the name or trade mark of

ATRITUBE HVAC PRODUCTS

15th str./ Block 48A, Sindos Industrial Area, 57020 Thessaloniki, Greece

and produced in the manufacturing plant

ATRITUBE HVAC PRODUCTS

15th str./ Block 48A, Sindos Industrial Area, 57020 Thessaloniki, Greece

This certificate attests that all provisions concerning the assessment and verification of constancy of performance described in Annex ZA of the standards


EN 1856-1:2009 and EN 1856-2:2009

under system 2+ are applied and that the factory production control is assessed to be in conformity with the applicable requirements.

This certificate was first issued on 05.07.2017 and will remain valid until 05.07.2020 as long as neither the harmonised standard, the construction product, the AVCP methods nor the manufacturing conditions in the plant are modified significantly, unless suspended or withdrawn by the notified factory production control certification body. The certificate is supported through annual surveillance audit and is reissued after each surveillance audit. The validity of the certificate may be confirmed in the CE register at the web address www.dedal-bg.net.



Issued:
Burgas, 05 July 2019

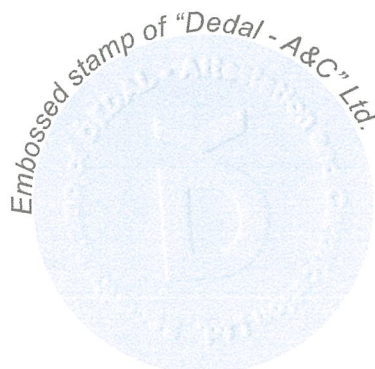

Manager:

arch. Galina Vasileva



ANNEX I TO CERTIFICATE OF CONFORMITY OF THE FACTORY PRODUCTION CONTROL 1922-CPR-0865/ 05.07.2019

Chimneys. Requirements for metal chimneys. System chimney products. Metal flue liners and connecting flue pipes, acc. to EN 1856-1:2009 and EN 1856-2:2009

DESCRIPTION	DESIGNATION
Atritube EX 316 CE® Single wall metal system chimney products: Internal Wall Material: stainless steel, No: 1.4404 (316L), Thicknesses 0,4 mm – 0,6 mm Diameters: from Ø80 to Ø600;	EN 1856-1 T200-P1-W-V2-L50(040-060)-O(40) EN 1856-2 T200-P1-W-V2-L50(040-060)-O(40) EN 1856-1 T450-N1-D-V2-L50(040-060)-G(400) EN 1856-2 T450-N1-D-V2-L50(040-060)-G(400)
Atritube EX 304 CE® Single wall metal system chimney products: Internal Wall Material: stainless steel, No: 1.4301 (304), Thicknesses 0,4 mm – 0,6 mm Diameters: from Ø80 to Ø600;	EN 1856-1 T200-P1-W-Vm-L20(040-060)-O(40) EN 1856-2 T200-P1-W-Vm-L20(040-060)-O(40) EN 1856-1 T450-N1-D-Vm-L20(040-060)-G(400) EN 1856-2 T450-N1-D-Vm-L20(040-060)-G(400)
Atritube CH 316 LD CE® Double wall metal system chimney products: External Wall Material: stainless steel, No: 1.4301 (304), Thicknesses 0,4 mm – 0,6 mm Internal Wall Material: stainless steel, No: 1.4404 (316L), Thicknesses 0,4 mm – 0,6 mm Insulation: mineral wool, Thickness: 25 mm Diameters: from Ø80 to Ø550;	EN 1856-1 T200-P1-D-V2-L50(040-060)-O(40) EN 1856-1 T450-N1-W-V2-L50(040-060)-G(150)
Atritube CH 304 LD CE® Double wall metal system chimney products: External Wall Material: stainless steel, No: 1.4301 (304), Thicknesses 0,4 mm – 0,6 mm Internal Wall Material: stainless steel, No: 1.4301 (304), Thicknesses 0,4 mm – 0,6 mm Insulation: mineral wool, Thickness: 25 mm Diameters: from Ø80 to Ø550;	EN 1856-1 T200-P1-D-Vm-L20(040-060)-O(40) EN 1856-1 T450-N1-W-Vm-L20(040-060)-G(150)
Atritube CH 316 HD CE® Double wall metal system chimney products: External Wall Material: stainless steel, No: 1.4301 (304), Thicknesses 0,4 mm – 0,6 mm Internal Wall Material: stainless steel, No: 1.4404 (316L), Thicknesses 0,4 mm – 0,6 mm Insulation: mineral wool, Thickness: 25 mm Diameters: from Ø80 to Ø550;	EN 1856-1 T200-P1-W-V2-L50(040-060)-O(40) EN 1856-1 T600-N1-D-V2-L50(040-060)-G(50)
Atritube CH 304 HD CE® Double wall metal system chimney products: External Wall Material: stainless steel, No: 1.4301 (304), Thicknesses 0,4 mm – 0,6 mm Internal Wall Material: stainless steel, No: 1.4301 (304), Thicknesses 0,4 mm – 0,6 mm Insulation: mineral wool, Thickness: 25 mm Diameters: from Ø80 to Ø550;	EN 1856-1 T200-P1-W-Vm-L20(040-060)-O(40) EN 1856-1 T600-N1-D-Vm-L20(040-060)-G(50)

*for diameters between 301mm and 450mm a multiplying factor of 1.5 should be applied to the designated distance to combustible materials and for diameters from 451 to 600 a factor of 2 shall be applied.



Issued:
Burgas, 05 July 2019



Manager:

arch. Galina Vasileva